

EZ-TRAP

Wiring instructions for installing the following Aspen Pumps into QUIETSIDE 9K & 12K (115V) minisplits:

Mini Orange Mini Lime Mini Aqua
Maxi Orange Maxi Lime

1. Check voltage at evaporator and ensure that pump voltage is correct.
2. Install 1 amp inline fuse between evaporator and pump to protect pump and unit.
3. Connect pump power cable to terminal block in evaporator as shown on diagram. This will ensure that pump is powered only when evaporator has power.

NOTE : DO NOT USE SEPARATE 115 VOLT OUTLET TO POWER PUMP AS THIS IS NOT FAIL SAFE AND MAY CAUSE AN OVERFLOW!


4. Connect alarm cable to indoor coil temperature sensor as shown in diagram using grey and purple wires only. Do not use orange wire, tape end to isolate.

NOTE : OVERFLOW ALARM WIRE MUST BE CONNECTED TO ENSURE THAT, IN CASE OF PUMP FAILURE OR BLOCKAGE IN DISCHARGE HOSE, EVAPORATOR WILL SHUT DOWN.

CONNECTION OF THE OVERFLOW ALARM CIRCUIT IS MANDATORY AND FAILURE TO DO SO WILL INVALIDATE PUMP WARRANTY!


**Mini Orange
Mini Lime
Mini Aqua**

115V AC

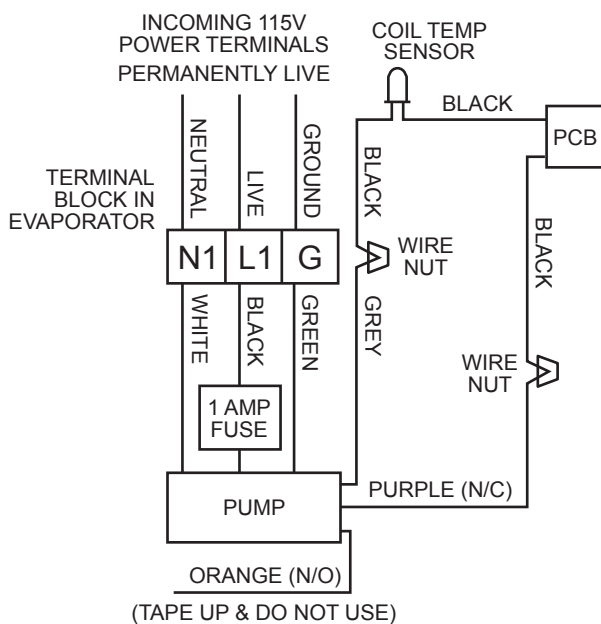

**Maxi Orange
Maxi Lime**

115V AC

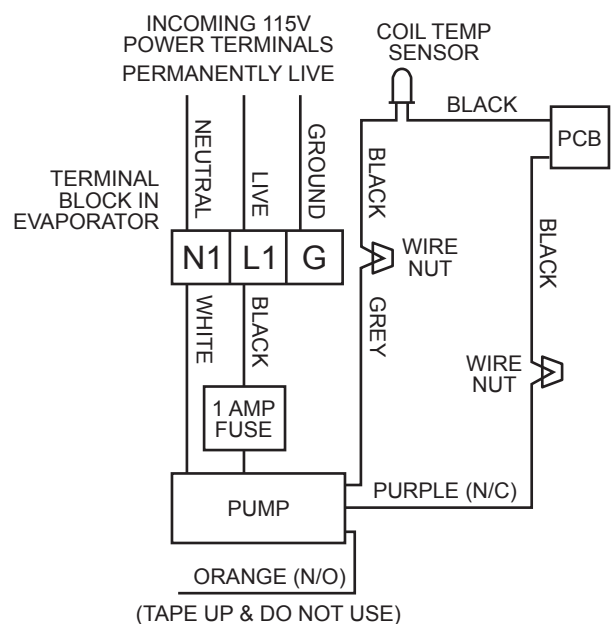

(NOTE: NO GROUND WIRE IS REQUIRED FOR 115V MAXI ORANGE & MAXI LIME PUMPS AS THEY ARE CLASS II APPLIANCES.)